

Receipt & Delivery Points, Park Service Points and Compression Details

	Responsible Party	Notional/ Physical	Park Service Points	Minimum Pressure (kPa)	Maximum Pressure (kPa)	Temperature or temperature range (°C)	Daily Capacity (TJ/d)	Hourly Capacity (GJ/h)	Allocation Agreement and Contact	Consents	Charges
Northern Receipt Zone											
Moomba Gas Plant Receipt Point	Shipper	Physical		6,200	7,322	0 – 71	450	18,750.0	Note 2	N/A	N/A
QSN Receipt Point	Shipper	Physical		6,200	7,322	0 – 50	300	12,500.0	Note 2	N/A	N/A
Park Receipt Point	Service Provider	Notional Park	Park Service Point Receipt point for delivery to any contracted delivery point	Note 1	Note 1	Note 1	Note 1	Note 1	Note 2	N/A	N/A
MoombaAP IPT	Service Provider	Notional		Note 1	Note 1	Note 1	Note 1	Note 1	Note 2	N/A	N/A
Southern Receipt Zone											
Pelican Point Receipt Point	Service Provider	Physical		7,500	15,300	0 – 50	125	5,210.0	Note 2	N/A	N/A
Adelaide IPT	Service Provider	Notional		Note 1	Note 1	Note 1	Note 1	Note 1	Note 2	N/A	N/A
Southern Receipt Zone											
Adelaide Metro Receipt Point	Service Provider	Notional		Note 1	Note 1	Note 1	Note 1	Note 1	Note 2	N/A	N/A
Northern Delivery Zone											
Moomba Withdrawal	Service Provider	Physical		6,200	6,600	0 – 50	80	3,330.0	Note 2	N/A	N/A
QSN Delivery	Note 1	Notional		Note 1	Note 1	Note 1	Note 1	Note 1	Note 2	N/A	N/A
MoombaAP IPT delivery	Note 1	Notional		Note 1	Note 1	Note 1	Note 1	Note 1	Note 2	N/A	N/A
Park Delivery	Note 1	Notional Park	Park Service Point Gas may be receipted from any receipt point in the Northern Receipt Zone for delivery to the Park Service Point	Note 1	Note 1	Note 1	Note 1	Note 1	Note 2	N/A	N/A
Mainline Rural Delivery Zone											
Beverley	Service Provider	Physical		2,000	4,000	0 – 50	1	41.6	Note 2	N/A	N/A
Hallett	Service Provider	Physical		4,000	7,300	20 - 32	96	4,000.0	Note 2	N/A	N/A
Burra	Service Provider	Physical		70	300	0 – 50	1.64	68.3	Note 2	N/A	N/A
Mintaro	Service Provider	Physical		1,700	2,100	0 – 50	32.3	1,345.8	Note 2	N/A	N/A
Wasleys Metro Farms	Service Provider	Physical		250	420	0 – 50	0.24	10.0	Note 2	N/A	N/A
Peterborough	Service Provider	Physical		250	450	0 – 50	1.01	42.0	Note 2	N/A	N/A
Angaston Delivery Zone											
Amcor	Service Provider	Physical		200	350	0 – 50	9.5	395.8	Note 2	N/A	N/A
Sheoak Log	Service Provider	Physical		250	420	0 – 50	0.1	4.1	Note 2	N/A	N/A
Nuriootpa	Service Provider	Physical		950	1,200	0 – 50	5.45	227.0	Note 2	N/A	N/A
Tanunda	Service Provider	Physical		950	1,200	0 – 50	2.4	100.0	Note 2	N/A	N/A
Angaston ABC	Service Provider	Physical		600	950	0 – 50	13.3	554.1	Note 2	N/A	N/A
Angaston Town	Service Provider	Physical		250	450	0 – 50	0.92	38.3	Note 2	N/A	N/A
Angaston Riverland	Service Provider	Physical		2,500	10,000	0 – 50	12	500.0	Note 2	N/A	N/A

	Responsible Party	Notional/ Physical	Park Service Points	Minimum Pressure (kPa)	Maximum Pressure (kPa)	Temperature or temperature range (°C)	Daily Capacity (TJ/d)	Hourly Capacity (GJ/h)	Allocation Agreement and Contact	Consents	Charges
Freeling	Service Provider	Physical		250	420	0 – 50	0.92	38.3	Note 2	N/A	N/A
Iron Triangle Delivery Zone											
Port Pirie	Service Provider	Physical		600	900	0 – 50	6.57	273.7	Note 2	N/A	N/A
Port Bonython	Service Provider	Physical		1,050	1350	0 – 50	10.1	420.8	Note 2	N/A	N/A
Pacific Salt	Service Provider	Physical		250	600	0 – 50	3.74	155.8	Note 2	N/A	N/A
Whyalla Town	Service Provider	Physical		125	220	0 – 50	1.29	53.7	Note 2	N/A	N/A
Whyalla Cogen	Service Provider	Physical		1850	2350	0 – 50	4.85	202.0	Note 2	N/A	N/A
Whyalla BHP	Service Provider	Physical		650	850	0 – 50	29	1,208.3	Note 2	N/A	N/A
Mainline Metro Delivery Zone											
Torrens Island PS	Service Provider	Physical		1,700	2,100		303	12,625.0	Note 2	N/A	N/A
Dry Creek	Service Provider	Physical		1,350	2,000	0 – 50	77	3,208.3	Note 2	N/A	N/A
Adelaide Metro	Service Provider	Physical Note 3		1,650	1,925	0 – 50	274.6	11,441.6	Adelaide Metro Allocation Agreement Contact: Service Provider	N/A	N/A
Bolivar PS	Service Provider	Physical		1,700	5,100	0 - 35	36	1,510	Note 2	N/A	N/A
Adelaide IPT	Service Provider	Notional		Note 1	Note 1	Note 1	Note 1	Note 1	Note 2	N/A	N/A
Loop line Delivery Zone											
Hi-Tech Hydroponics	Service Provider	Physical		70	385	0 – 50	0.23	9.5	Note 2	N/A	N/A
Frost Road	Service Provider	Physical		400	550	0 – 50	4.8	200.0	Note 2	N/A	N/A
Virginia	Service Provider	Physical		250	420	0 – 50	0.92	38.3	Note 2	N/A	N/A
Pelican Point	Service Provider	Physical		1,700	3900	0 – 50	140	5,833.3	Note 2	N/A	N/A
Snapper Point PS	Service Provider	Physical		1,700	5,100	0 - 35	45.60	2,500	Note 2	N/A	N/A
Quarantine PS	Service Provider	Physical		1,750	3,000	20 - 40	28	1,166.6	Note 2	Consent is required from the owner of the Quarantine Power Station. Requests for access should be directed through the Service Provider	N/A
Osborne	Service Provider	Physical		1,700	3160	0 – 50	53.3	2,220.8	Note 2	N/A	N/A



Note 1 – Points are notional and therefore pressure is deemed to be the pressure and temperature requirements are those prevailing in the pipeline system and daily and hourly capacity is subject to any counter flow at the point on a day.

Note 2 – Allocation are completed in accordance with the relevant Gas Transportation Agreement

Note 3 – Adelaide Metro Delivery Point comprises the Elizabeth, Taperoo and Gepps Cross delivery points

Note 4 – the location of each Receipt Point and Delivery Point can be identified in the map below.

Formatted Table

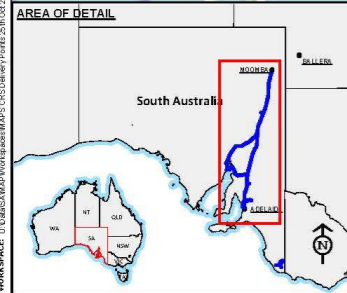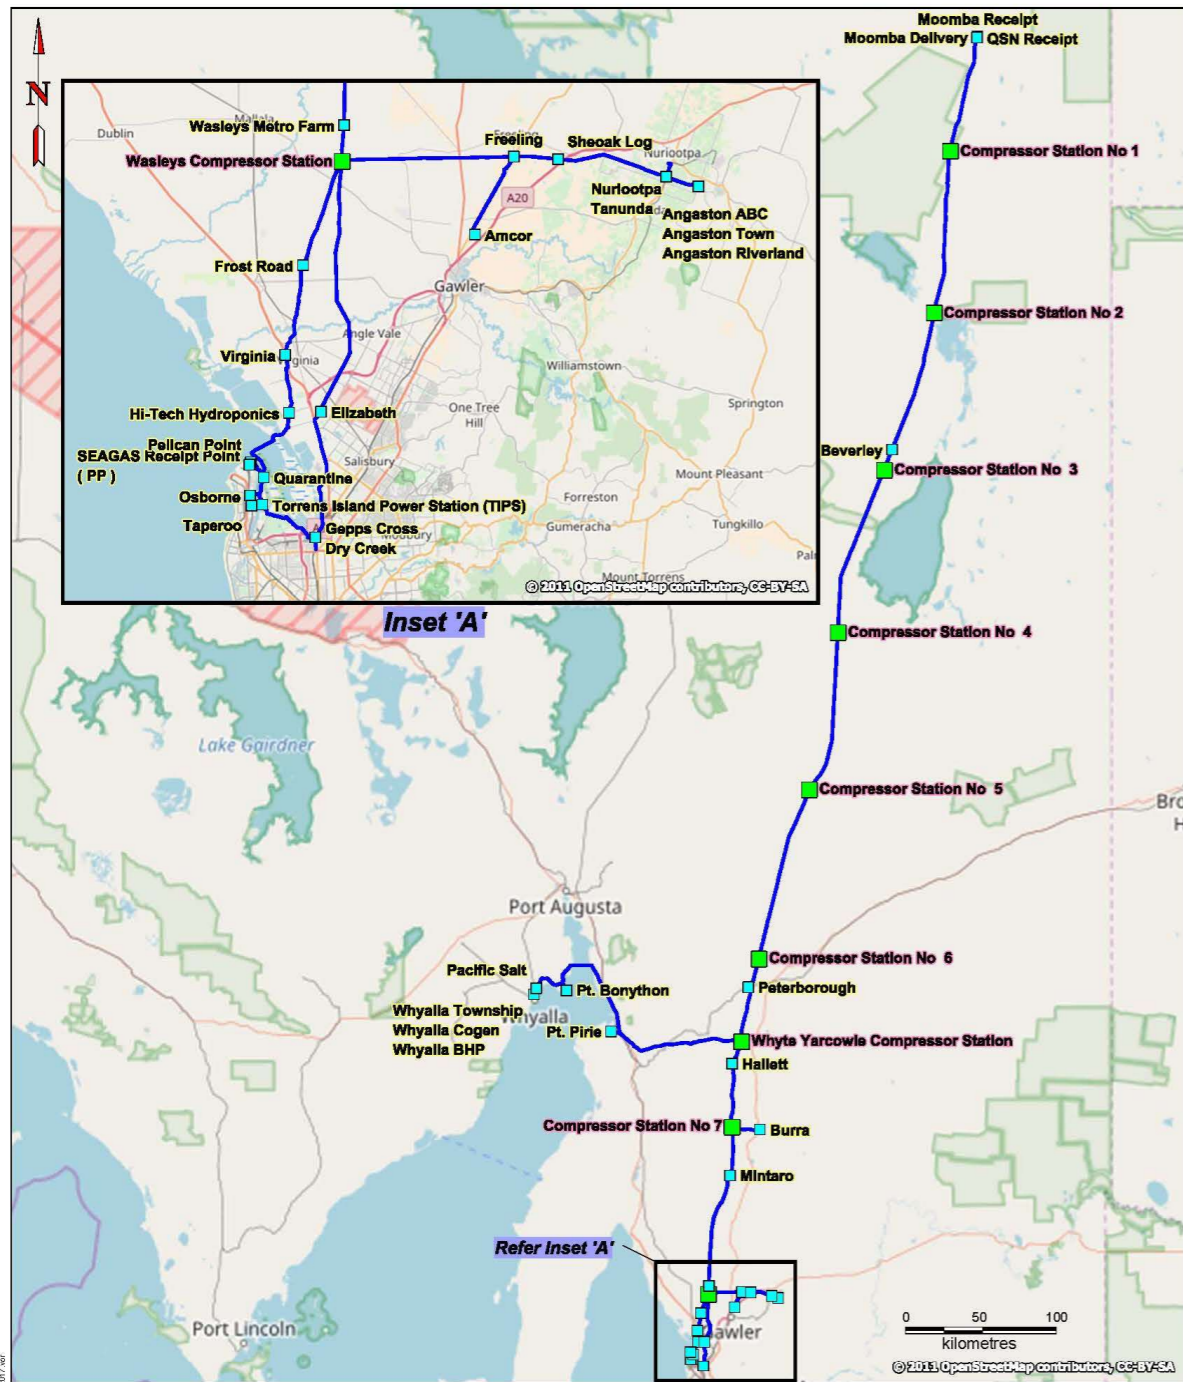

LEGEND

- Compressor Stations
- Epic Energy MAPS Gas Pipelines
- Receipt and Delivery Points

COMPANY: Epic Energy
PROJECT: Epic Energy Gas Pipelines
TITLE: MAPS Operational Information Summary
DATE: 25-October-2017
DATA SOURCE: As-built pipeline supplied by Epic Energy Pipeline facilities supplied by Epic Energy 250k Raster Topographic map copyright of Comm of Aust.

Adelaide (Head Office) 26 High Street Dry Creek SA 5094 PH: (08) 8343 8100

WORKSPACE: U:\Data\MAPS\Workspaces\MAPS_CED\Delivery Points\251017\251017.dwg

Epic Energy disclaims any liability for the accuracy or completeness of the information contained in this document and makes no warranty, express or implied, about the information. Epic Energy is not liable for any damage (including consequential losses) arising from the use of this information.